

| TEE SIZE (mm) | A (mm) | B (mm) | |
|---------------|--------|--------|--|
| 150x150x150 | 273 | 533 | |
| 200x200x150 | 298 | 584 | |
| 250x250x150 | 349 | 686 | |
| 300x300x150 | 375 | 736 | |
| 400x400x150 | 425 | 762 | |



MECHANICAL JOINT ANCHOR TEE

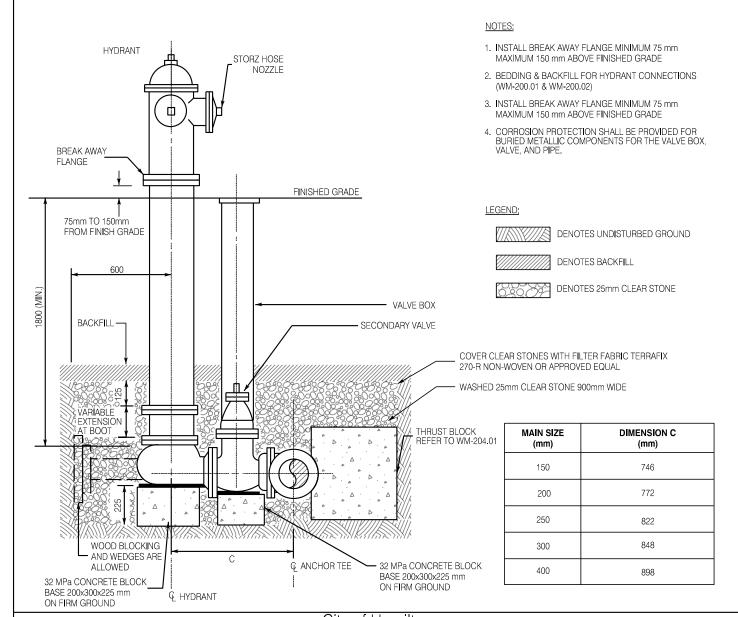

City of Hamilton Public Works Department

HYDRANT INSTALLATION USING ANCHOR TEE

| DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE NOTED (N.T.S.) | DATE June 2025 | REV No 2 | FORMERLY: RWS 604 | HAMILTON STD No | WM-203.02 |
|---|-------------------|-------------|-------------------|-----------------|-----------|
|---|-------------------|-------------|-------------------|-----------------|-----------|