



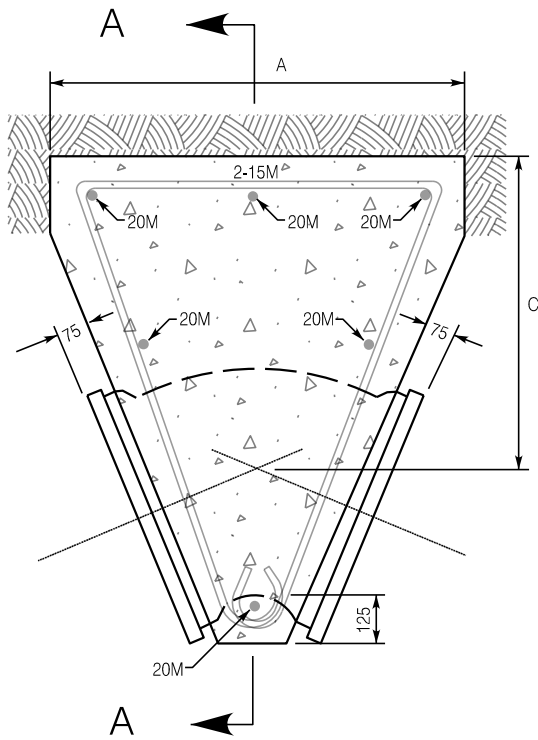

PLAN VIEW

		PIPE DIA. (mm)					
		400	450	500	600	750	900
MIN. DIMENSION (mm)	A	900	1000	1150	1200	1700	2000
	B	800	900	1000	1250	1400	1650
	C	725	750	750	900	1050	1200

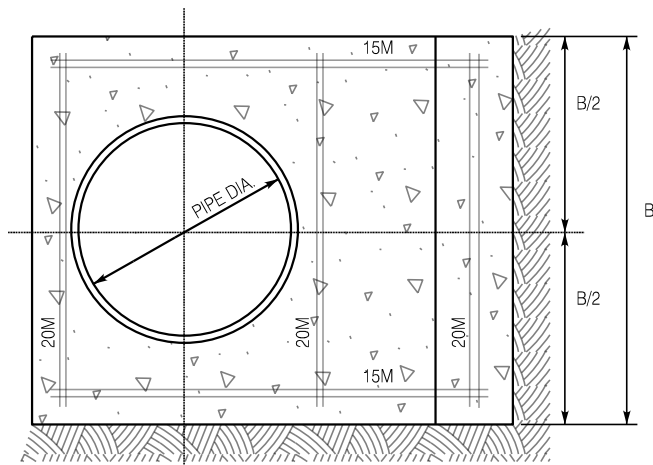

SECTION A-A

NOTES:

1.  DENOTES UNDISTURBED GROUND.
2. ALL CONCRETE TO BE 32 MPa.
3. MINIMUM COVER OF CONCRETE OVER REINFORCING TO BE 75mm
4. ALL REINFORCING STEEL TO BE GRADE 400.
5. JOINT BOLTS TO BE PLACED PRIOR TO POURING CONCRETE.

City of Hamilton
Public Works Department

**45° ANGLE ANCHOR BLOCK DETAILS FOR
400mm TO 900mm DIA. D.I. WATERMAINS**

DIMENSIONS SHOWN ARE IN MILLIMETRES
UNLESS OTHERWISE NOTED (N.T.S.)

DATE
June 2025

REV No
2

FORMERLY: RWS-402

HAMILTON STD No

WM-204.03