


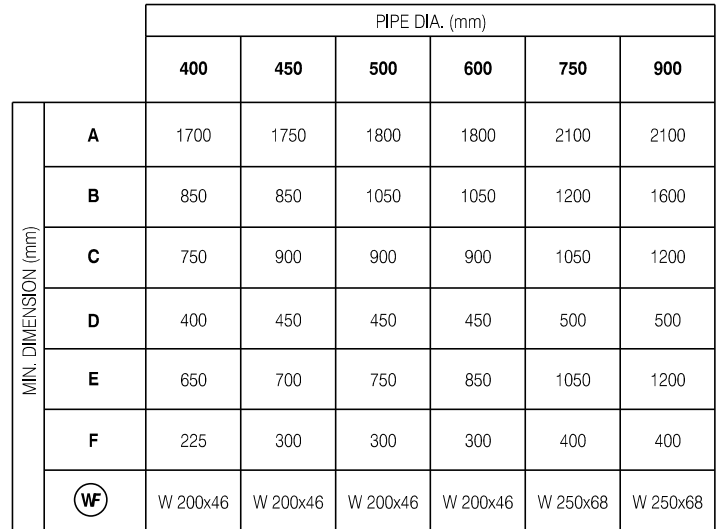

1. DENOTES UNDISTURBED GROUND.
2. ALL CONCRETE TO BE 32 MPa.
3. MINIMUM COVER OF CONCRETE OVER REINFORCING TO BE 75mm
4. ALL REINFORCING STEEL TO BE GRADE 400.
5. JOINT BOLTS TO BE PLACED PRIOR TO POURING CONCRETE.

45° ANGLE ANCHOR BLOCK WITH LEG FOR 400mm TO 900mm DIA. D.I. WATERMAINS