



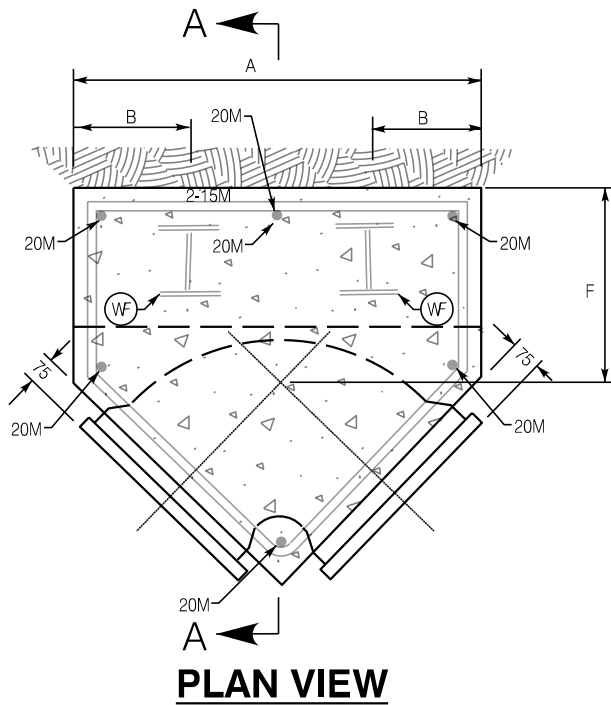

		PIPE DIA. (mm)					
		400	450	500	600	750	900
MIN. DIMENSION (mm)	A	1050	1200	1300	1300	1650	2050
	B	300	300	350	350	400	450
	C	400	400	450	450	500	600
	D	2000	2000	2300	2300	2600	3000
	E	900	1100	1400	1400	1500	1800
	F	600	650	700	750	900	1200
	WF	W200x46	W200x46	W200x46	W250x115	W250x115	W300x128

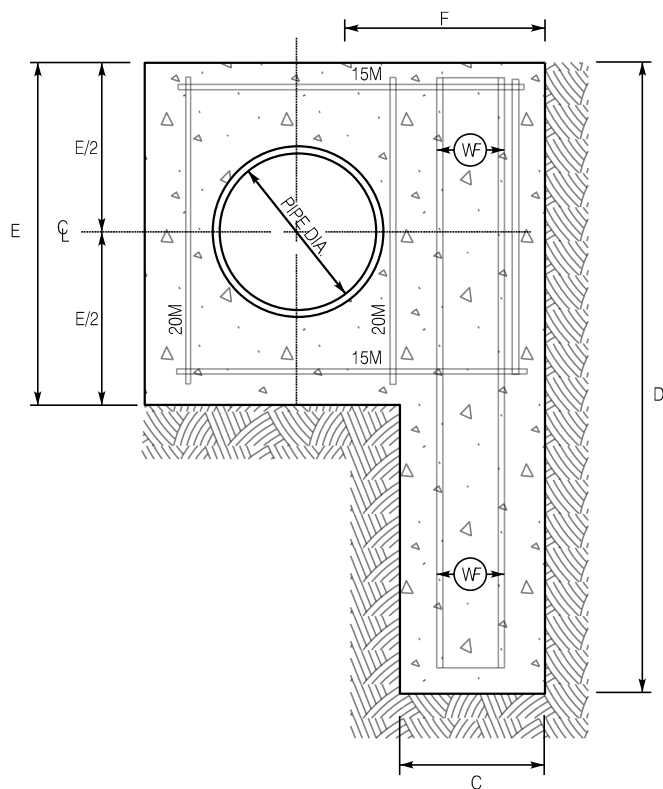

NOTES:

1.  DENOTES UNDISTURBED GROUND.
2. ALL CONCRETE TO BE 32 MPa.
3. MINIMUM COVER OF CONCRETE OVER REINFORCING TO BE 75mm
4. ALL REINFORCING STEEL TO BE GRADE 400.
5. JOINT BOLTS TO BE PLACED PRIOR TO POURING CONCRETE.

City of Hamilton
Public Works Department

**90° ANGLE ANCHOR BLOCK WITH LEG FOR
400mm TO 900mm DIA. D.I. WATERMAINS**

DIMENSIONS SHOWN ARE IN MILLIMETRES
UNLESS OTHERWISE NOTED (N.T.S.)

DATE
June 2025

REV No
2

FORMERLY: RWS-406

HAMILTON STD No

WM-204.06