



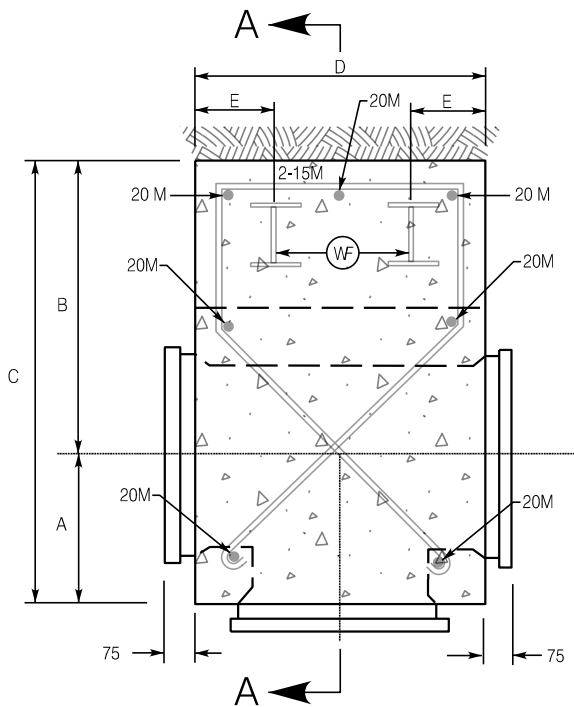


PLAN VIEW

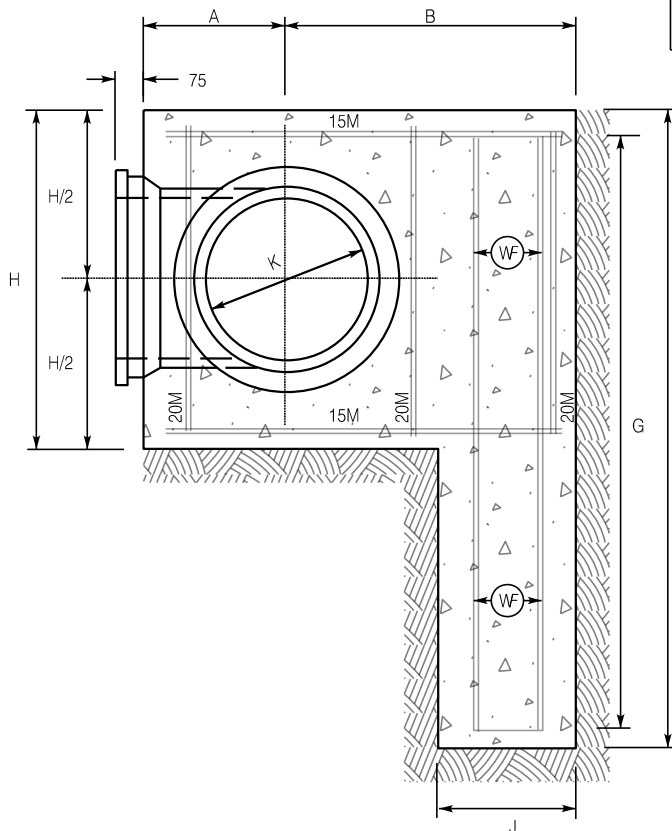

SECTION A-A

		BRANCH PIPE DIA. (mm)					
		400	450	500	600	750	900
MIN. DIMENSION (mm)	A	380	430	460	560	600	650
	B	800	850	900	900	1000	1200
	C	1180	1280	1360	1460	1600	1850
	D	750	850	900	1100	1200	1500
	E	225	225	225	325	350	350
	F	2000	2000	2300	2300	2500	3000
	G	1850	1850	2150	2150	2350	2550
	H	900	950	1050	1200	1300	1500
	J	450	450	450	450	500	600
	K	400	450	500	600	750	900
	WF	W200x46	W200x46	W200x46	W250x115	W250x115	W300x128

NOTES:

1.  DENOTES UNDISTURBED GROUND.
2. ALL CONCRETE TO BE 32 MPa.
3. MINIMUM COVER OF CONCRETE OVER REINFORCING TO BE 75MM.
4. ALL REINFORCING STEEL TO BE GRADE 400.
5. JOINT BOLTS TO BE PLACED PRIOR TO POURING CONCRETE.

City of Hamilton
Public Works Department

**TEE ANCHOR BLOCK WITH LEG FOR
400mm TO 900mm DIA. D.I. BRANCH WATERMAINS**

DIMENSIONS SHOWN ARE IN MILLIMETRES
UNLESS OTHERWISE NOTED (N.T.S.)

DATE
June 2025

REV No
2

FORMERLY: RWS-407

HAMILTON STD No

WM-204.08