



**SIDE ELEVATION**

		PIPE DIA. (mm)				
		100	150	200	250	300
MIN. DIMENSION (mm)	A	900	900	1050	1300	1500
	B	800	850	1000	1200	1350
	C	550	650	850	950	1100
	D	150	150	200	200	300
	E	300	300	400	550	600

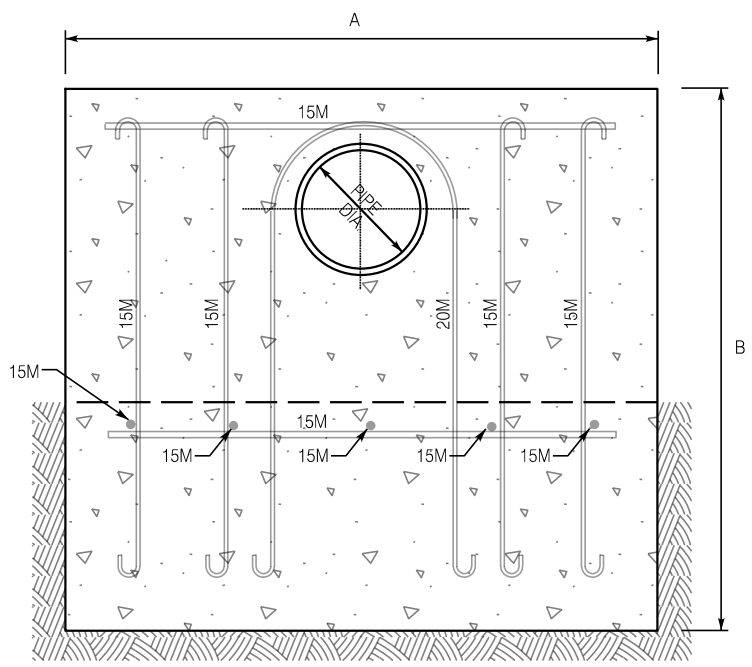

**SECTION A-A**

**NOTES:**

1.  DENOTES UNDISTURBED GROUND.
2. ALL CONCRETE TO BE 32 MPa.
3. MINIMUM COVER OF CONCRETE OVER REINFORCING TO BE 75mm.
4. ALL REINFORCING STEEL TO BE GRADE 400.
5. FLANGE BOLTS TO BE PLACED PRIOR TO POURING CONCRETE.

City of Hamilton  
Public Works Department

**CONCRETE ANCHOR BLOCK FOR  
100mm TO 300mm DIA. D.I. WATERMAIN @ 11-¼° & 22-½° VERTICAL BENDS**

DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE NOTED (N.T.S.)	DATE June 2025	REV No 2	FORMERLY: RWS-408	HAMILTON STD No <b>WM-204.10</b>
--	-------------------	-------------	-------------------	-------------------------------------