


		PIPE DIA. (mm)				
		100	150	200	250	300
MIN. DIMENSION (mm)	A	1000	1200	1400	1500	1800
	B	900	1000	1150	1450	1550
	C	700	850	1150	1500	1650
	D	150	150	200	200	250
	E	350	400	500	600	700

**SIDE ELEVATION**

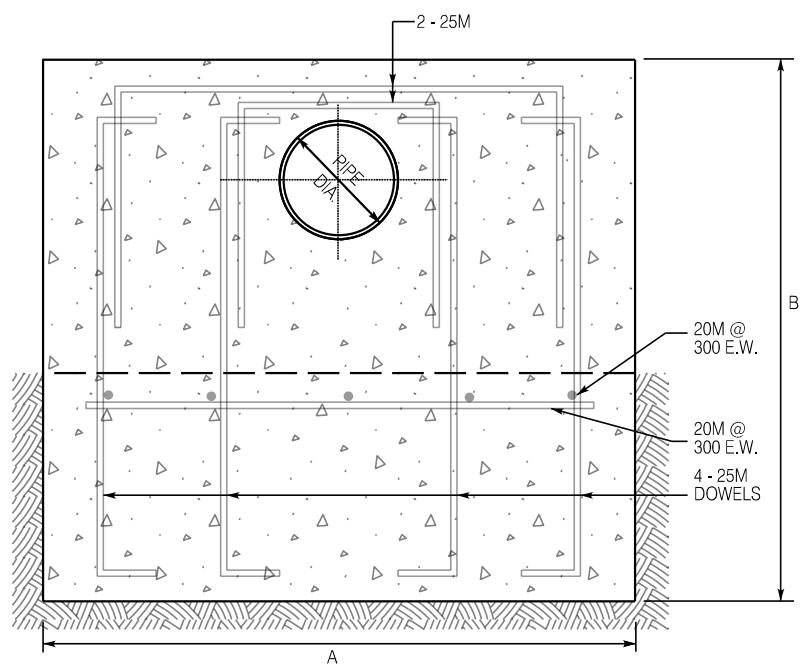

**SECTION A-A**

**NOTES:**

1. DENOTES UNDISTURBED GROUND.
2. ALL CONCRETE TO BE 32 MPa.
3. MINIMUM COVER OF CONCRETE OVER REINFORCING TO BE 75mm.
4. ALL REINFORCING STEEL TO BE GRADE 400.
5. FLANGE BOLTS TO BE PLACED PRIOR TO POURING CONCRETE.

City of Hamilton  
Public Works Department

**CONCRETE ANCHOR BLOCK FOR  
100mm TO 300mm DIA. D.I. WATERMAIN @ 45° VERTICAL BEND**