




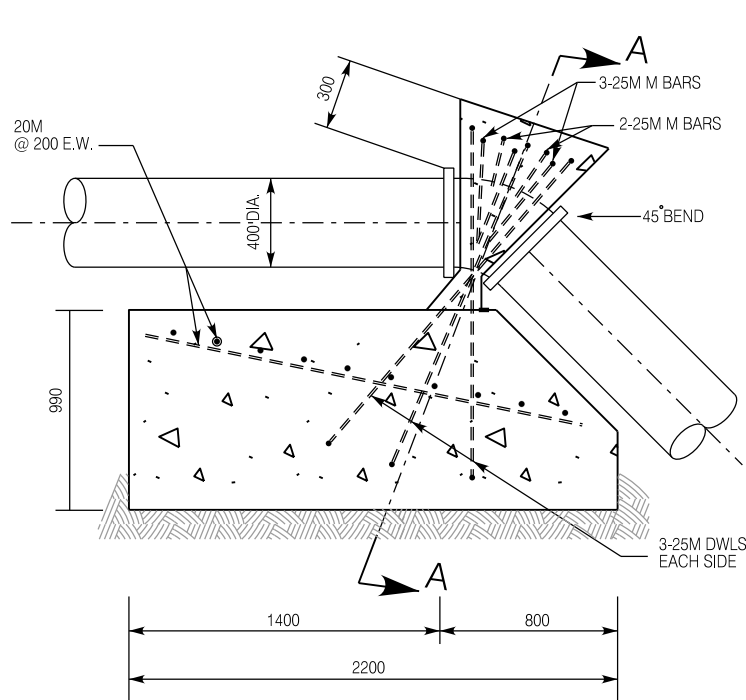


FOR UPWARD THRUST

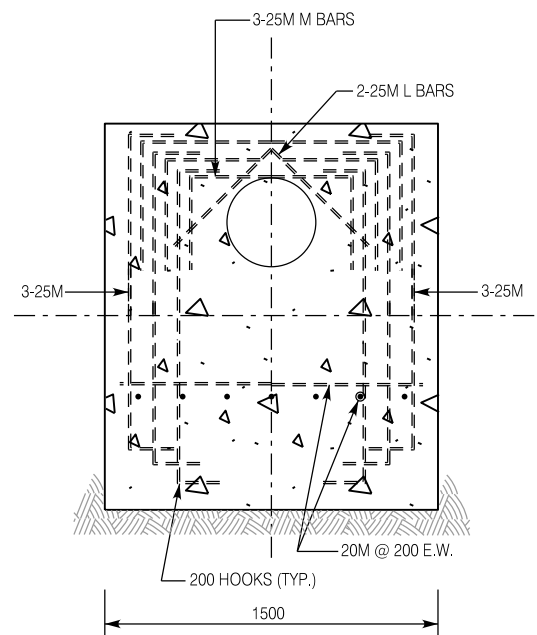

SECTION A-A

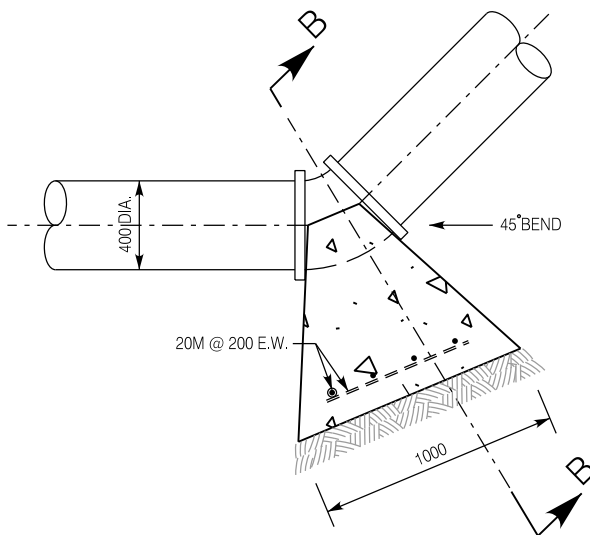

FOR DOWNWARD THRUST

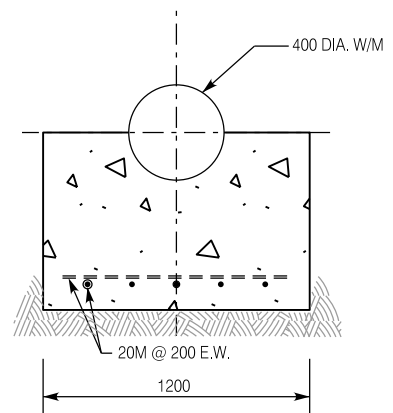

SECTION B-B

NOTES:

1.  DENOTES UNDISTURBED GROUND.
2. ALL CONCRETE TO BE 40 MPa.
3. MINIMUM COVER OF CONCRETE OVER REINFORCING TO BE 75mm.
4. ALL REINFORCING STEEL TO BE GRADE 400.

City of Hamilton
Public Works Department

**VERTICAL BEND ANCHOR BLOCK
45° FOR 400mm DIA WATERMAIN**

DIMENSIONS SHOWN ARE IN MILLIMETRES
UNLESS OTHERWISE NOTED

DATE: DRAFT
NOVEMBER 2018

REV No

HAMILTON STD No

WM-204.14