


# SIDE ELEVATION (DETAIL B)

### SECTION B-B

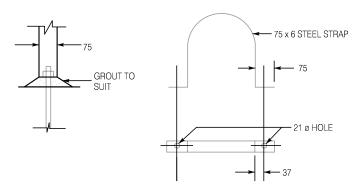

## STEEL STRAPPING DETAILS

#### NOTES:

- 1. DENOTES UNDISTURBED GROUND.
- 2. ALL CONCRETE TO BE 32 MPa.
- 3. MINIMUM COVER OF CONCRETE OVER REINFORCING TO BE 75mm.
- 4. ALL REINFORCING STEEL TO BE GRADE 400.

		22 ½° BEND		45° BEND	
		А	В	A	В
PIPE DIA. (mm)	150	900	550	1100	800
	200	1050	700	1400	900
	250	1200	850	1600	1100
	300	1400	950	1700	1300

MIN. DIMENSION (mm)

### City of Hamilton Public Works Department

## CONCRETE ANCHOR BLOCK FOR 100mm TO 300mm DIA.WATERMAIN LOWERING

DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE NOTED (N.T.S.)

DATE

June 2025

REV No

FORMERLY: RWS-413(2)

HAMILTON STD No

WM-204.15