



NOTES:

1. MINIMUM 5 WATER SERVICES AND A MAXIMUM OF 20 WATER SERVICES REQUIRED FOR EFFECTIVE LOOPING

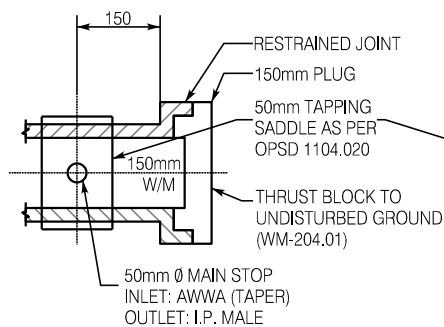

DUCTILE IRON INSTALLATION

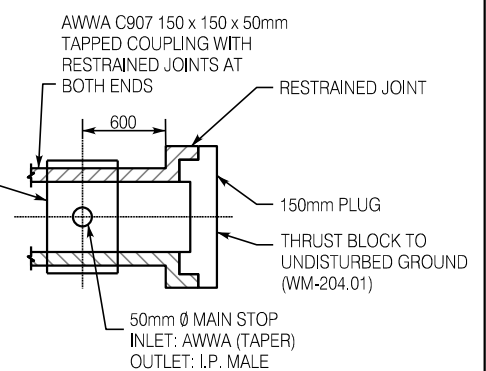

PVC INSTALLATION

City of Hamilton
Public Works Department

50mm WATERMAIN LOOPING IN CUL-DE-SACS (20m R.O.W.)

DIMENSIONS SHOWN ARE IN MILLIMETRES
UNLESS OTHERWISE NOTED (N.T.S.)

DATE
June 2025

REV No
2

HAMILTON STD No

WM-205.01