


NOTES :

1. BEDDING DETAILS (WM-200.01 & WM-200.02)
2. INSTALLATION DETAILS (WM-207.02)
3. ALL FITTINGS TO CONFORM TO CITY STANDARDS
4. CATHODIC PROTECTION IS REQUIRED FOR COPPER WATER SERVICES CONNECTING TO PVC W/M
5. WHERE SIDEWALK EXTENDS TO STREET LINE, CURB STOP TO BE INSTALLED WITH 300mm CLEARANCE FROM STREET LINE TO CENTRE OF CURB STOP.
6. ALLOW FOR WOOD BLOCKING (TYPICAL)

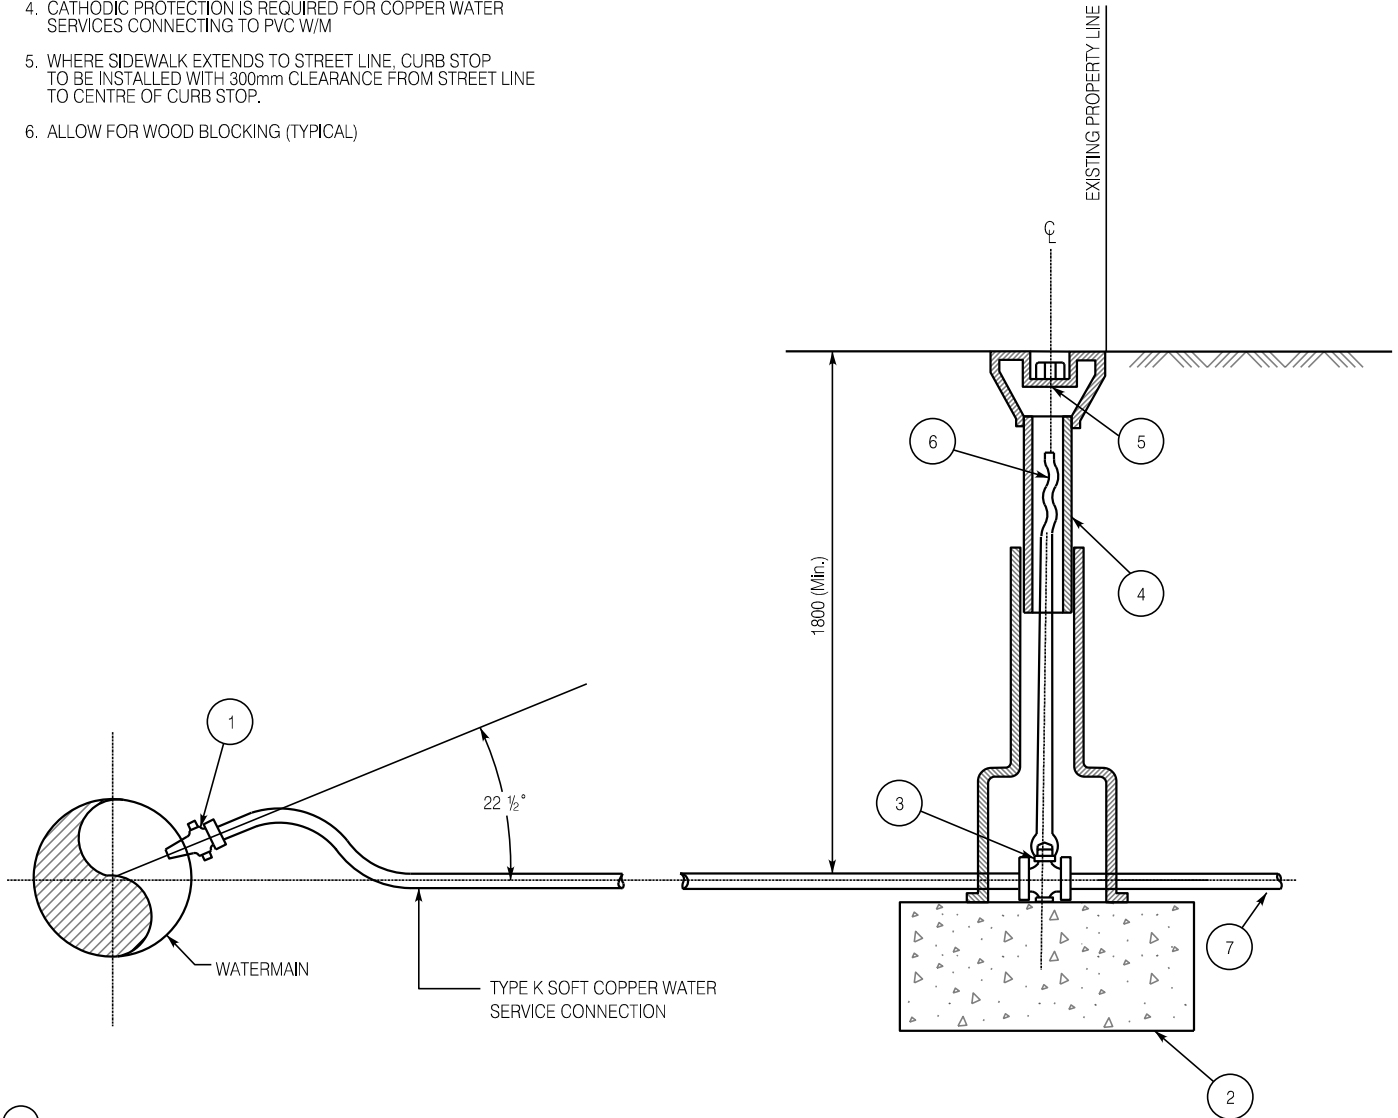

- 1 MAIN STOP - A.W.W.A. TAPER THREAD TO C.F.
- 2 32 MPa CONCRETE BLOCK BASE 200x250x250mm OR WOOD BLOCKING ON FIRM GROUND
- 3 CURB STOP - AS PER CITY APPROVED WATERMAIN PRODUCTS LIST - C.F. BOTH ENDS (TO BE CLOSED)
- 4 EXTENSION BARREL - 2 PIECES
- 5 BRONZE PLUG
- 6 STAINLESS STEEL ROD
- 7 END TO BE CRIMPED CLOSED (FOR STUB ONLY)

City of Hamilton
Public Works Department

**PIPING ARRANGEMENT FOR 19mm TO 25mm DIA. WATER SERVICE
CONNECTION AND YARD SERVICE**

DIMENSIONS SHOWN ARE IN MILLIMETRES
UNLESS OTHERWISE NOTED (N.T.S.)

DATE
June 2025

REV No
2

FORMERLY: RWS 700 (Sheet 1 & 2)

HAMILTON STD No

WM-207.01