


PLAN VIEW

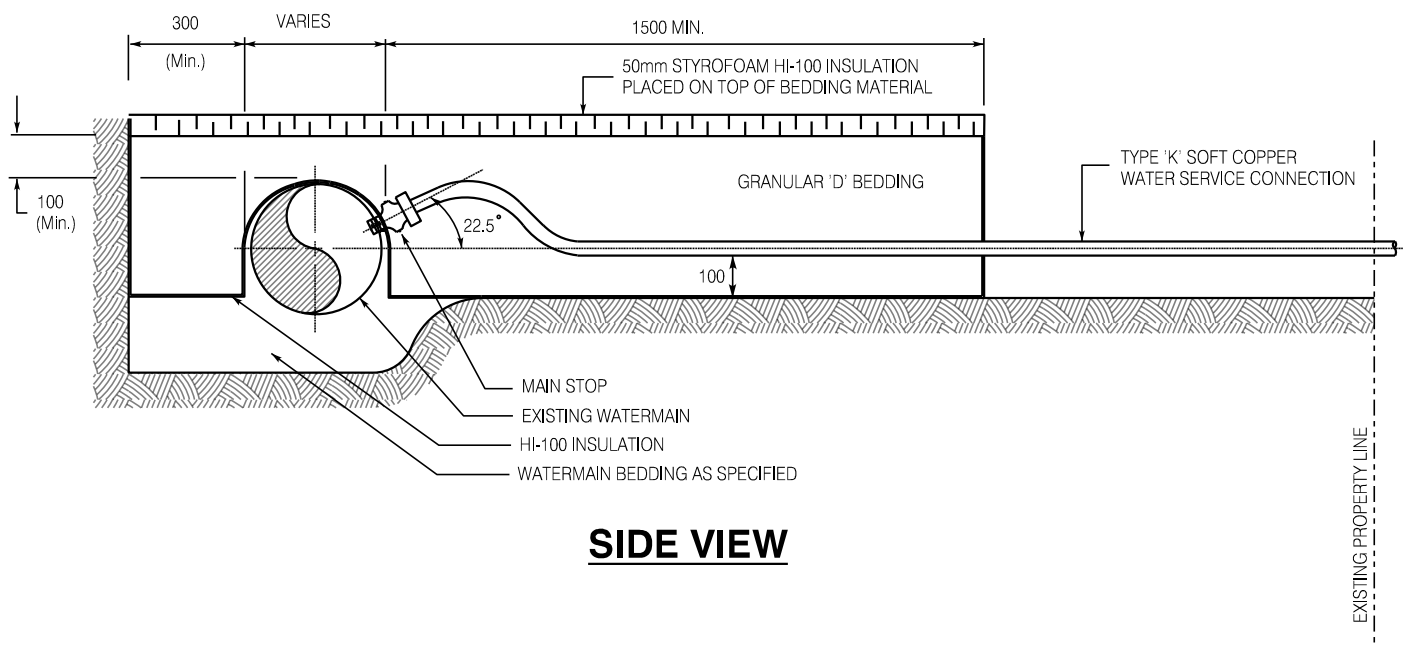

SIDE VIEW

NOTE:

INSULATE UNTIL WATER SERVICE HAS A MINIMUM OF 1800mm COVER OR AS DIRECTED

City of Hamilton
Public Works Department

INSULATION DETAILS FOR WATER SERVICES AT GOOSENECK

DIMENSIONS SHOWN ARE IN MILLIMETRES
UNLESS OTHERWISE NOTED (N.T.S.)

DATE
June 2025

REV No
2

FORMERLY: RWS 712

HAMILTON STD No

WM-207.03