


NOTES:

- A. ALL WATER SERVICES TO BE INSTALLED 90° TO THE LONGITUDINAL AXIS OF THE WATERMAIN.
- B. BEDDING DETAILS (WM-200.01 & WM-200.02)
- C. ALL FITTINGS TO CONFORM TO CITY STANDARDS
- D. CATHODIC PROTECTION IS REQUIRED FOR COPPER WATER SERVICES CONNECTING TO PVC W/M
- E. WHERE SIDEWALK EXTENDS TO PROPERTY LINE, CURB STOP TO BE INSTALLED WITH 300mm CLEARANCE FROM PROPERTY LINE TO CENTRE OF CURB STOP.

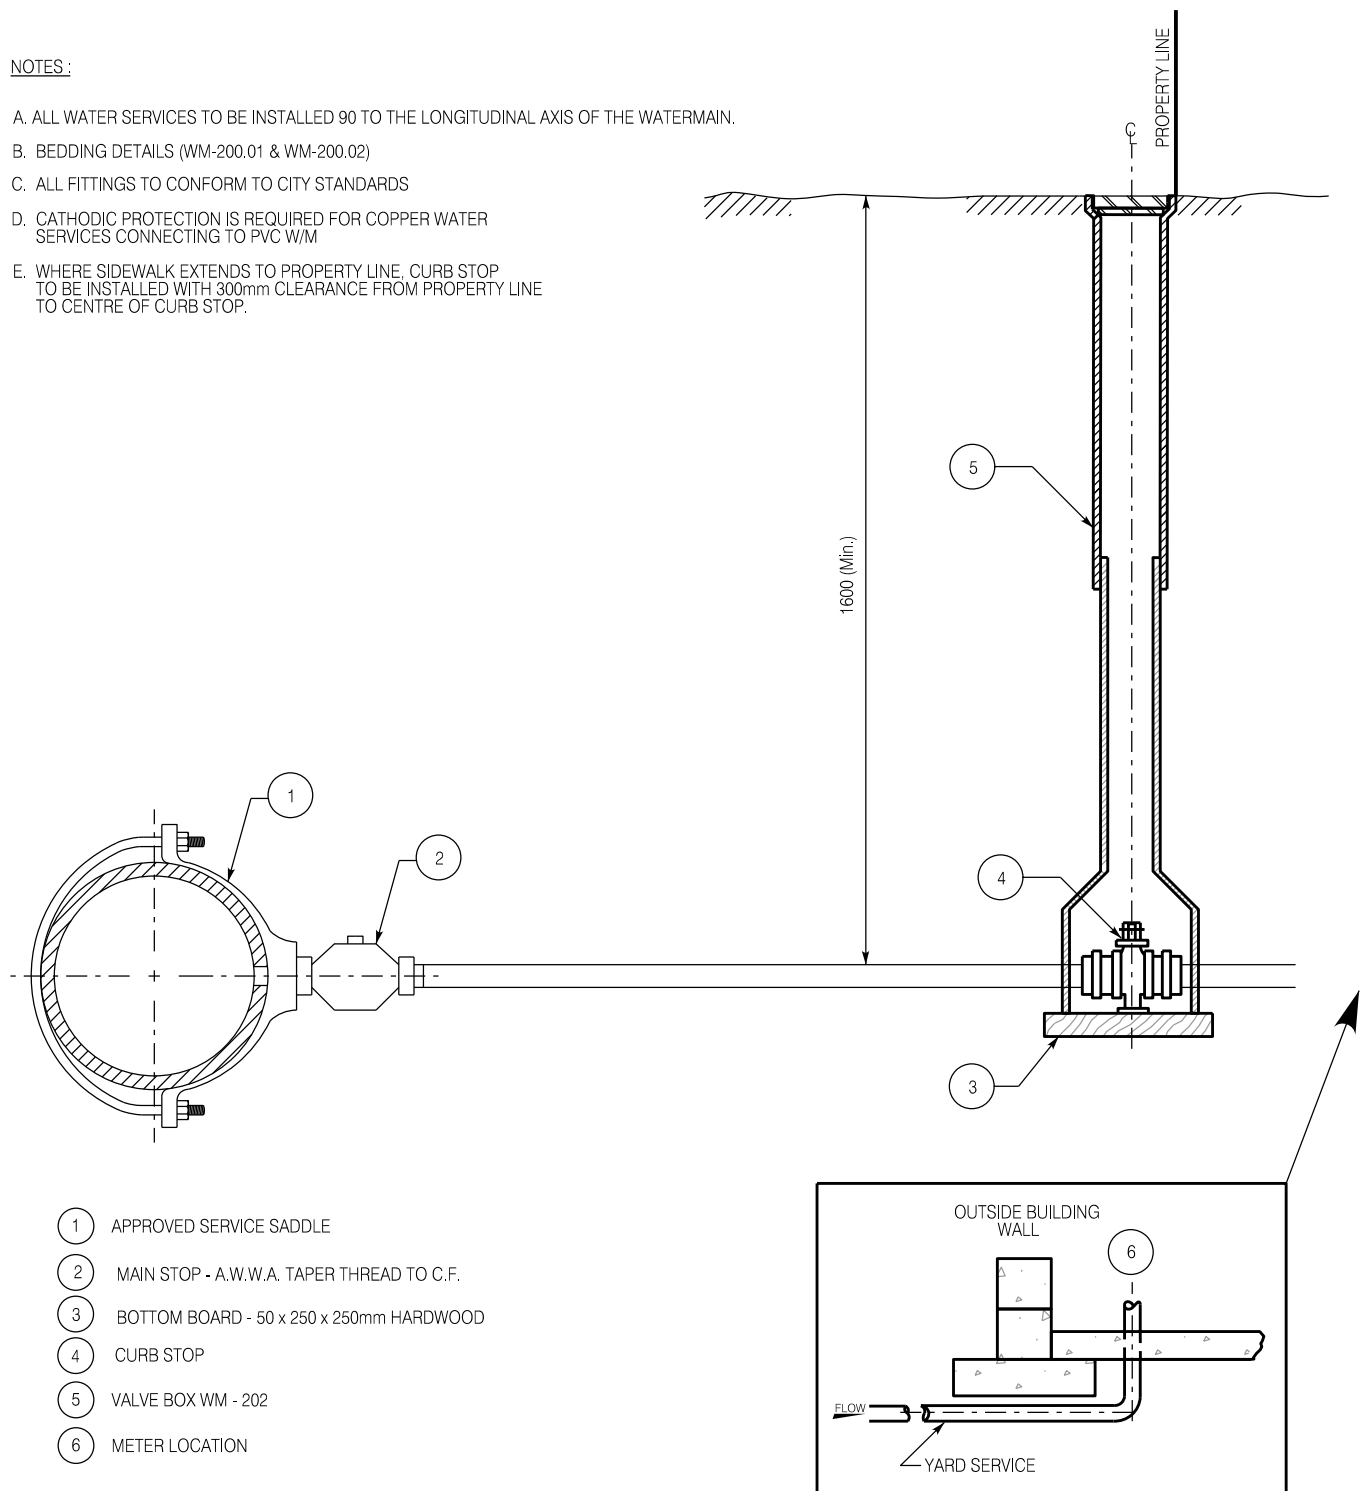

City of Hamilton
Public Works Department

**PIPING ARRANGEMENT FOR 50mm DIA. WATER SERVICE
CONNECTION AND YARD SERVICE**

DIMENSIONS SHOWN ARE IN MILLIMETRES
UNLESS OTHERWISE NOTED (N.T.S.)

DATE
January 2020

REV No

FORMERLY:

HAMILTON STD No

WM-207.06