


METER PIT

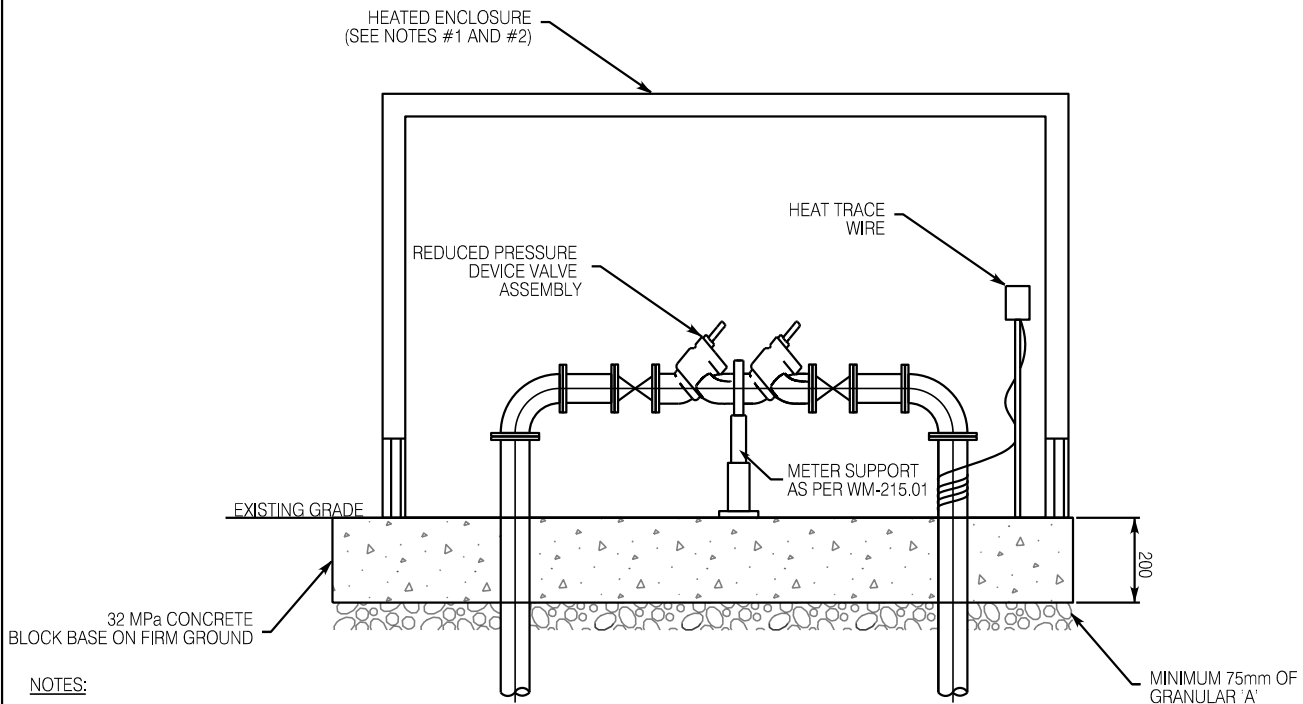

NOTES:

1. APPLICABLE BACKFLOW PREVENTION ASSEMBLY TO BE PLACED NO MORE THAN 3.0m DOWNSTREAM OF THE METER/BY-PASS ASSEMBLY
2. FOR INSULATED ENCLOSURE INSTALLATION REFER TO BY LAW B64.10-11

INSULATED ENCLOSURE

City of Hamilton
Public Works Department

METER BOX AND INSULATED ENCLOSURE FOR TEMPORARY CONSTRUCTION WATER 16mm TO 38mm DIA. METER INSTALLATION

DIMENSIONS SHOWN ARE IN MILLIMETRES
UNLESS OTHERWISE NOTED (N.T.S.)

DATE
June 2025

REV No
1

FORMERLY:

HAMILTON STD No

WM-209.04