



## REMOTE INSTALLATION AT HYDRO MAST

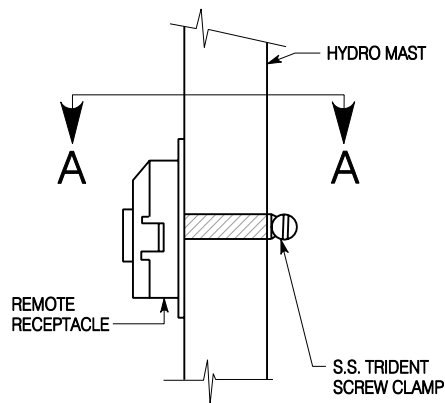

## SECTION A-A

## REMOTE INSTALLATION ON BUILDING

### NOTES:

1. LOCATION OF REMOTE READING DEVICE SHALL BE TO THE SATISFACTION OF THE CITY.
2. REMOTE WIRE TO BE FASTENED EVERY 300mm ON EXTERIOR WALLS AND EVERY 1000mm ON INTERIOR WALLS.
3. REMOTE READING DEVICE INSTALLATION TO BE ON HYDRO MAST WHERE POSSIBLE.

City of Hamilton  
Public Works Department

## STANDARD REMOTE INSTALLATIONS FOR 16mm TO 25mm DIA. METERS

DIMENSIONS SHOWN ARE IN MILLIMETRES  
UNLESS OTHERWISE NOTED (N.T.S.)

DATE  
November 2005

REV No

FORMERLY: RWS 714

HAMILTON STD No

**WM-211.01**