


**PIPING AND CHAMBER FOR MULTI-UNIT RESIDENTIAL (3 STOREYS AND ABOVE)
OR ICI MODERATE HAZARD 100mm TO 250mm DIA. METER INSTALLATION
(1800mm x 2400mm AND 1800mm x 3000mm PRECAST METER CHAMBERS)**

WM-234.02

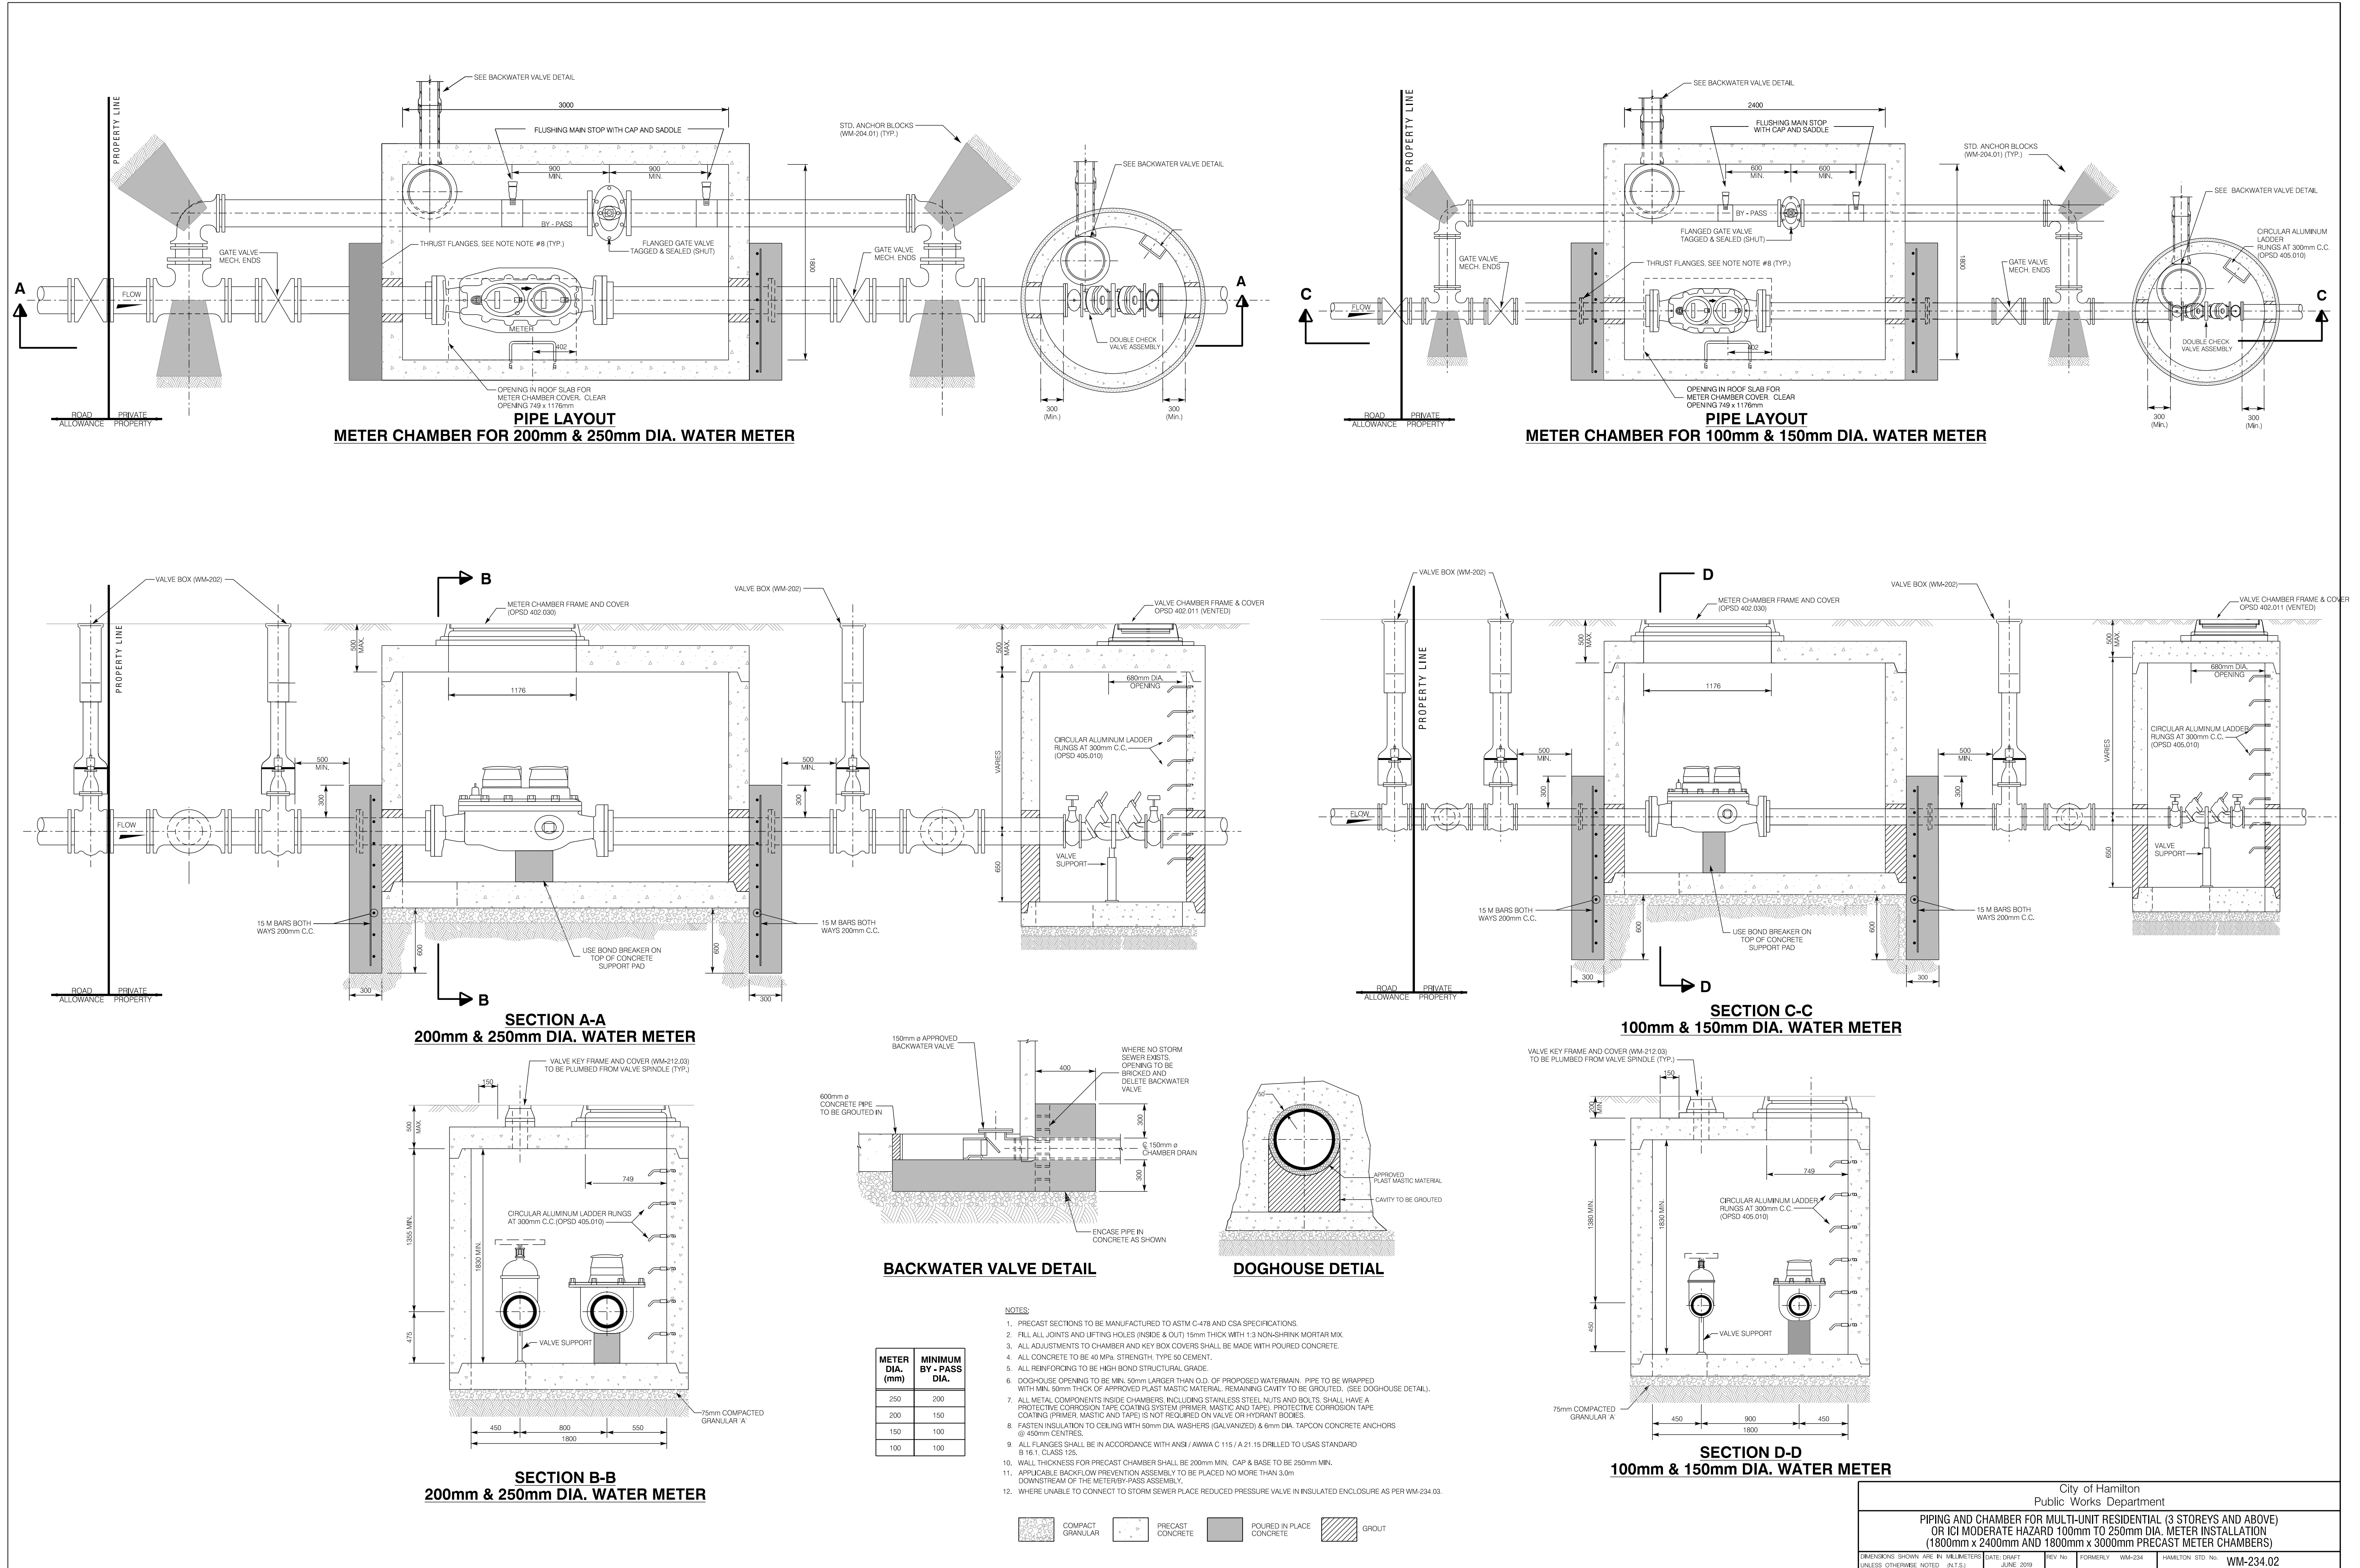

METER DIA. (mm)	MINIMUM BY-PASS DIA.
250	200
200	150
150	100
100	100

City of Hamilton
Public Works Department

PIPING AND CHAMBER FOR MULTI-UNIT RESIDENTIAL (3 STOREYS AND ABOVE)
OR ICI MODERATE HAZARD 100mm TO 250mm DIA. METER INSTALLATION
(1800mm x 2400mm AND 1800mm x 3000mm PRECAST METER CHAMBERS)

DATE DRAFT: JUNE 2019
REV NO: 01
FORMERLY: WM-234
HAMILTON STD NO: WM-234.02