



PLAN VIEW



SECTION A-A

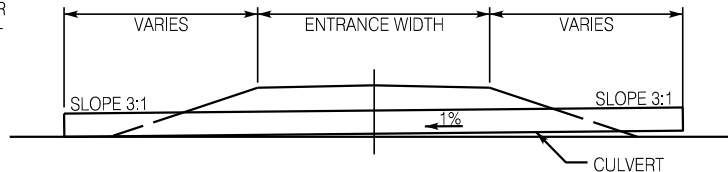

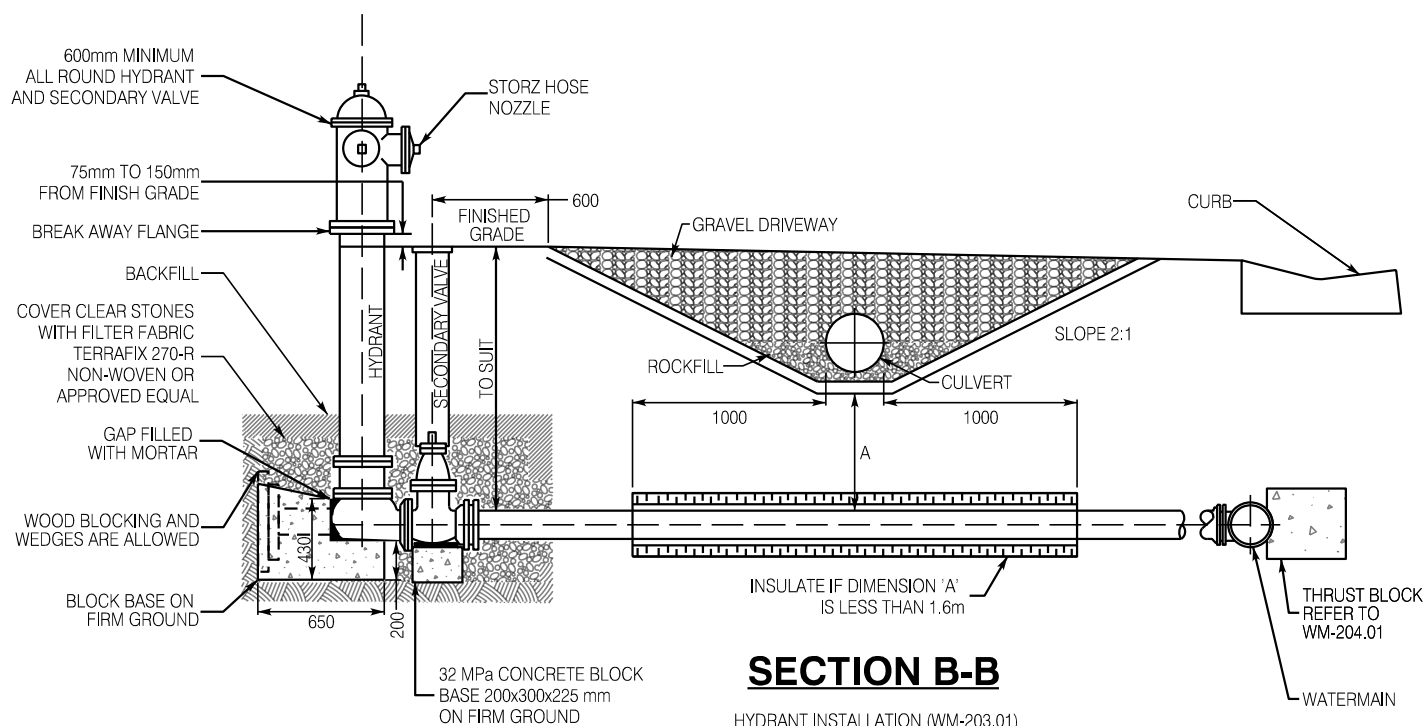

SECTION B-B

HYDRANT INSTALLATION (WM-203.01)

NOTES:

1. INSTALL BREAK AWAY FLANGE MINIMUM 75 mm
MAXIMUM 150 mm ABOVE FINISHED GRADE
2. IF THE DISTANCE FROM HYDRANT TO WATERMAIN IS
7.5m AND GREATER, INSTALL A SECONDARY VALVE
3. INSTALL BREAK AWAY FLANGE MINIMUM 75 mm
MAXIMUM 150 mm ABOVE FINISHED GRADE
3. CORROSION PROTECTION SHALL BE PROVIDED FOR
BURIED METALLIC COMPONENTS FOR THE VALVE BOX,
VALVE AND PIPE.
4. MATCH HYDRANT DRAWING WM-203.01

LEGEND:

-  DENOTES UNDISTURBED GROUND.
-  DENOTES BACKFILL.

City of Hamilton
Public Works Department

ACCESS TO FIRE HYDRANT BEHIND THE DITCH

DIMENSIONS SHOWN ARE IN MILLIMETRES
UNLESS OTHERWISE NOTED (N.T.S.)

DATE
June 2025

REV No
1

FORMERLY:

HAMILTON STD No

WM-243.05